

Perda de carga singular em condutos



PMC 3222

Prof. Marcos Tadeu Pereira

2019

(Diversas figuras retiradas da internet sem identificação de origem)

Resumo

- 1) Equação da Continuidade fluido incompressível, regime permanente, em um duto:

A vazão mássica é dada por $\dot{m} = \rho_1 V_1 s_1 = \rho_2 V_2 s_2$

- 2) Equação da Energia, mesmas condições:

$$H_1 - H_2 = \left(\frac{\alpha_1 V_1^2}{2g} + \frac{P_1}{\gamma} + z_1 \right) - \left(\frac{\alpha_2 V_2^2}{2g} + \frac{P_2}{\gamma} + z_2 \right) = \frac{\dot{w}_a}{\gamma Q} - \frac{\dot{w}_m}{\gamma Q}$$

- 3) Equação da Quantidade de Movimento mesmas condições:

$$\sum F_{ext} = \sum \dot{m}_e V_e - \sum \dot{m}_s V_s$$

Resumo cont.

4) Equação de Darcy-Weisbach

$$h_f = f \frac{l}{D} \frac{V^2}{2g}$$


5) Equação de Colebrook

$$\frac{1}{\sqrt{f}} = 1.14 - 2 \log \left(\frac{\varepsilon}{D} + \frac{9.35}{\mathbf{Re} \sqrt{f}} \right)$$

6) Diagramas de Moody e de Rouse



CURVA CARACTERÍSTICA DA BOMBA E PERDAS DO SISTEMA

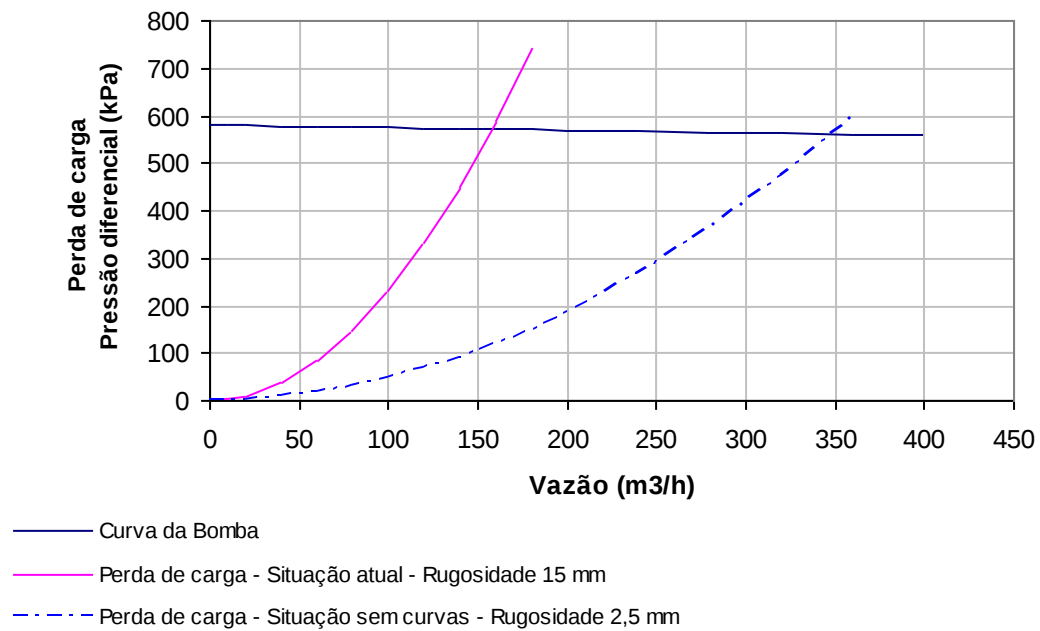

Economic velocity

$$d = \sqrt{\frac{4V_s}{\pi u}}$$

$u \uparrow$

$\longrightarrow d \downarrow$

pipes' cost $\downarrow$

pumping cost $\uparrow$, due to frictional loss

Fluids	Economic velocities (m/s)	Fluids	Economic velocities (m/s)
Water and liquids of low viscosities	0.5~3	High-pressure gas	15~25
Oil and liquids of high viscosities	0.5~1	Saturated steam	
Low-pressure gas	8~20	<1MPa	15~20
		1~4MPa	20~40
		4~12MPa	40~60

Cálculo das perdas de carga singulares (*minor losses*)

Assim com as perdas de carga distribuídas ao longo de trechos retos de dutos, cada singularidade introduz uma perda de carga adicional nos sistemas fluidos.

Estas perdas ocorrem em:

- Entrada ou saída de dutos;
- Expansões ou contrações, bruscas ou suaves;
- “T”s, cotovelos, joelhos, curvas e outras conexões;
- Válvulas, abertas total ou parcialmente;
- Mudanças de seção devido à introdução de corpos no interior das tubulações (p.ex. medidores de vazão, de temperatura, filtros, grades, etc)

Perda de carga distribuída em duto reto:

$$h_f = f \frac{l}{D} \frac{V^2}{2g}$$

A perda singular é representada por h_s :

$$\frac{\gamma h_s}{\frac{1}{2} \rho V^2} = k_s \left(\frac{\rho V D}{\mu}, \text{coef. de forma da singularidade} \right)$$

$$h_s = k_s \frac{V^2}{2g} \text{ ou } h_f = f \frac{l_{eq}}{D} \frac{V^2}{2g}$$





Onde k_s é o coeficiente de perda de carga singular, adimensional




e l_{eq} é o comprimento equivalente, em metros, da perda de carga causada pela singularidade

Observar que k_s é o equivalente a f , e depende geralmente do número de Reynolds e de um fator de forma da singularidade (no caso de f a singularidade depende de Reynolds e de ε/D)

A perda de carga total em uma instalação hidráulica é dada por:

$$h_{total} = \sum h_f + \sum h_s$$

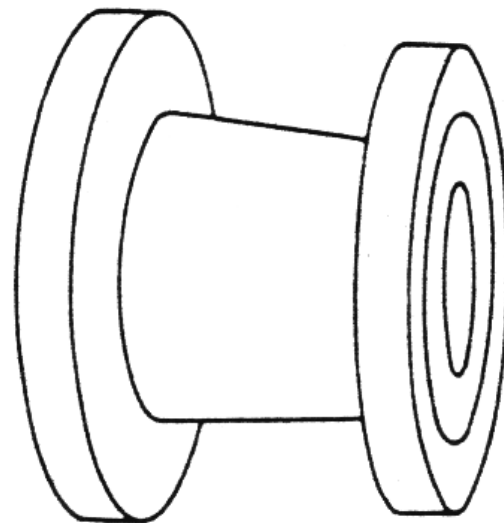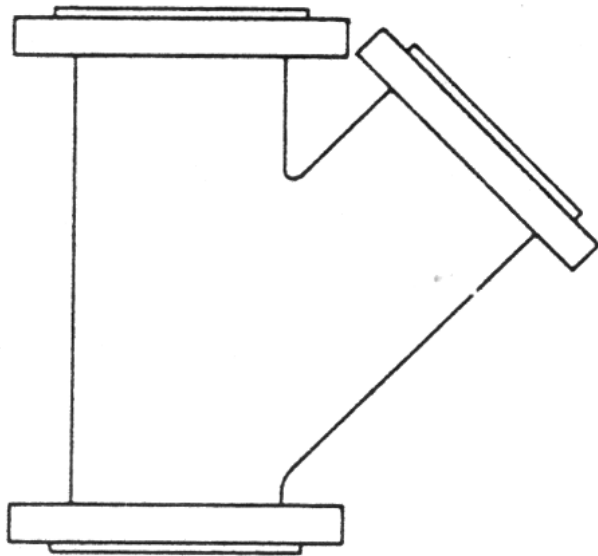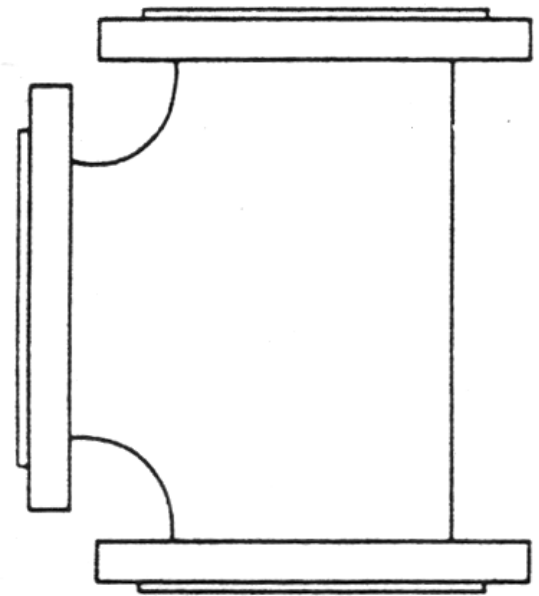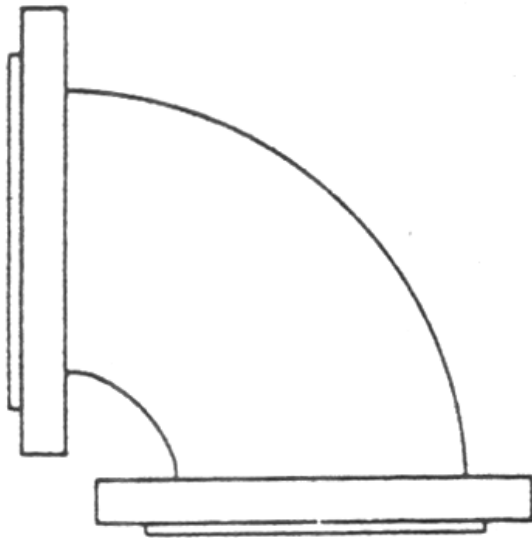

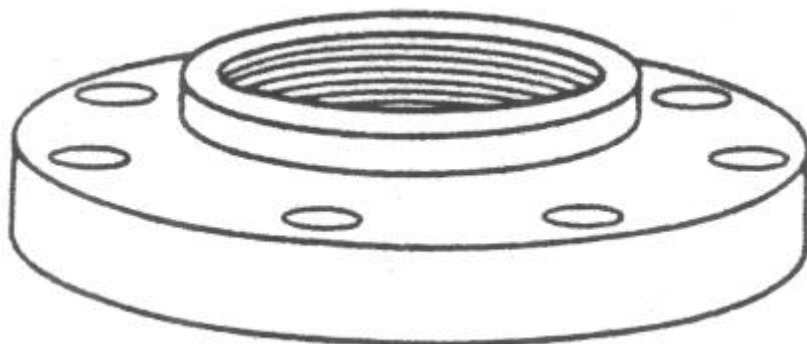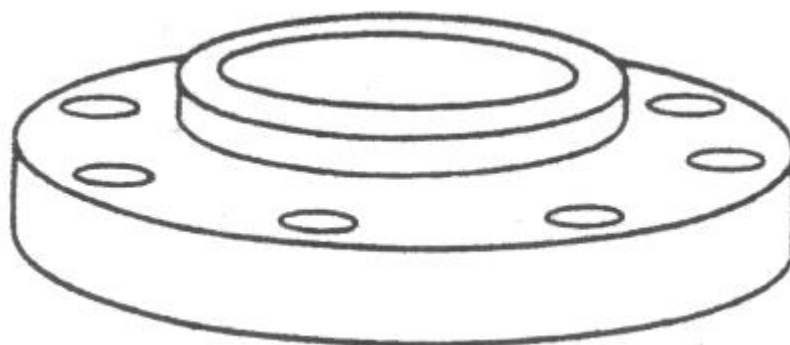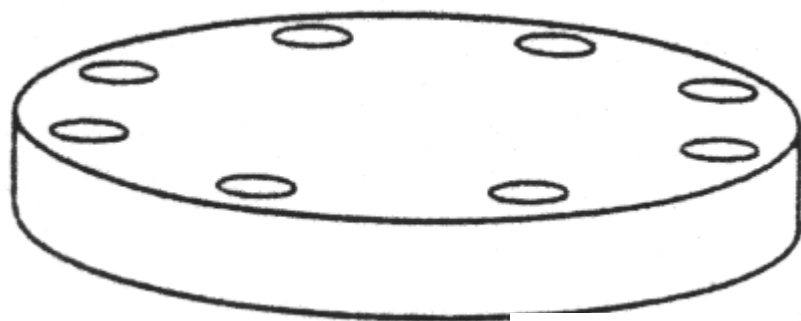




1



2



3



4



5



11



12



13



14



6



10



9



8



7

Comprimentos equivalentes a perdas localizadas. (Expressos em metros de canalização retilínea)*

DIÂMETRO D mm pol	COTOVELO 90° RAIO LONGO COTOVELO 90° RAIO MÉDIO COTOVELO 90° RAIO CURTO COTOVELO 45° CURVA 90° R/D · 1½ CURVA 90° R/D · 1 CURVA 45° ENTRADA NORMAL ENTRADA DE BORDA REGISTRO DE GAVETA ABERTO REGISTRO DE GLOBO ABERTO REGISTRO DE ÂNGULO ABERTO TÊ PASSAGEM DIRETA TÊ SAÍDA DE LADO TÊ SAÍDA BILATERAL VÁLVULA DE PE E CRIVO SAÍDA DA CANALIZ. VÁLVULA DE RETENÇÃO TIPO LEVE VÁLVULA DE RETENÇÃO TIPO PÊNADO																			
	                  																			
13	1/2	6,3	0,4	0,5	0,2	0,2	0,2	0,2	0,2	0,4	0,1	4,9	2,6	0,3	1,0	1,0	3,6	0,4	1,1	1,6
19	3/4	0,4	0,6	0,7	0,3	0,3	0,4	0,2	0,2	0,5	0,1	6,7	3,6	0,4	1,4	1,4	5,6	0,5	1,6	2,4
25	1	0,5	0,7	0,8	0,4	0,3	0,5	0,2	0,3	0,7	0,2	8,2	4,6	0,5	1,7	1,7	7,3	0,7	2,1	3,2
32	1 1/4	0,7	0,9	1,1	0,5	0,4	0,6	0,3	0,4	0,9	0,2	11,3	5,6	0,7	2,3	2,3	10,0	0,9	2,7	4,0
38	1 1/2	0,9	1,1	1,3	0,6	0,5	0,7	0,3	0,5	1,0	0,3	13,4	6,7	0,9	2,8	2,8	11,6	1,0	3,2	4,8
50	2	1,1	1,4	1,7	0,8	0,6	0,9	0,4	0,7	1,5	0,4	17,4	8,5	1,1	3,5	3,5	14,0	1,5	4,2	6,4
63	2 1/2	1,3	1,7	2,0	0,9	0,8	1,0	0,5	0,9	1,9	0,4	21,0	10,0	1,3	4,3	4,3	17,0	1,9	5,2	8,1
75	3	1,6	2,1	2,5	1,2	1,0	1,3	0,6	1,1	2,2	0,5	26,0	13,0	1,6	5,2	5,2	20,0	2,2	6,3	9,7
100	4	2,1	2,8	3,4	1,5	1,3	1,6	0,7	1,6	3,2	0,7	34,0	17,0	2,1	6,7	6,7	23,0	3,2	6,4	12,9
125	5	2,7	3,7	4,2	1,9	1,6	2,1	0,9	2,0	4,0	0,9	43,0	21,0	2,7	8,4	8,4	30,0	4,0	10,4	16,1
150	6	3,4	4,3	4,9	2,3	1,9	2,5	1,1	2,5	5,0	1,1	51,0	26,0	3,4	10,0	10,0	39,0	5,0	12,5	19,3
200	8	4,3	5,5	6,4	3,0	2,4	3,3	1,5	3,5	6,0	1,4	67,0	34,0	4,3	13,0	13,0	52,0	6,0	16,0	25,0
250	10	5,5	6,7	7,9	3,8	3,0	4,1	1,8	4,5	7,5	1,7	85,0	43,0	5,5	16,0	16,0	65,0	7,5	20,0	32,0
300	12	6,1	7,9	9,5	4,6	3,6	4,8	2,2	5,5	9,0	2,1	102,0	51,0	6,1	19,0	19,0	78,0	9,0	24,0	38,0
350	14	7,3	9,5	10,5	5,3	4,4	5,4	2,5	6,2	11,0	2,4	120,0	60,0	7,3	22,0	22,0	90,0	11,0	28,0	45,0


*Os valores indicados para registros de globo aplicam-se também às torneiras, válvulas para chuveiros e válvulas de descarga

Type	Equivalent Length in Pipe Diameters L_e/D
Globe valve—fully open	340
Angle valve—fully open	150
Gate valve—fully open	8
— $3/4$ open	35
— $1/2$ open	160
— $1/4$ open	900
Check valve—swing type	100
Check valve—ball type	150
Butterfly valve—fully open, 2–8 in	45
—10–14 in	35
—16–24 in	25
Foot valve—poppet disc type	420
Foot valve—hinged disc type	75
90° standard elbow	30
90° long radius elbow	20
90° street elbow	50
45° standard elbow	16
45° street elbow	26
Close return bend	50
Standard tee—with flow through run	20
—with flow through branch	60

Source: Crane Valves, Signal Hill, CA.

Coefficientes de perda localizada $K = h_{pf}/[V^2/(2g)]$ para válvulas abertas, cotovelos e tês.


	Diâmetro nominal, pol (mm)									
	Parafusada					Flangeada				
	$\frac{1}{2}$ (13)	1 (25)	2 (50)	4 (100)		1 (25)	2 (50)	4 (100)	8 (200)	20 (500)
Válvulas (totalmente abertas):										
Globo	14	8,2	6,9	5,7		13	8,5	6,0	5,8	5,5
Gaveta	0,3	0,24	0,16	0,11		0,80	0,35	0,16	0,07	0,03
Retenção basculante	5,1	2,9	2,1	2,0		2,0	2,0	2,0	2,0	2,0
Em ângulo	9,0	4,7	2,0	1,0		4,5	2,4	2,0	2,0	2,0
Cotovelos:										
45° normal	0,39	0,32	0,30	0,29						
45° raio longo						0,21	0,20	0,19	0,16	0,14
90° normal	2,0	1,5	0,95	0,64		0,50	0,39	0,30	0,26	0,21
90° raio longo	1,0	0,72	0,41	0,23		0,40	0,30	0,19	0,15	0,10
180° normal	2,0	1,5	0,95	0,64		0,41	0,35	0,30	0,25	0,20
180° raio longo						0,40	0,30	0,21	0,15	0,10
Tês:										
Escoamento direto	0,90	0,90	0,90	0,90		0,24	0,19	0,14	0,10	0,07
Escoamento no ramal	2,4	1,8	1,4	1,1		1,0	0,80	0,64	0,58	0,41

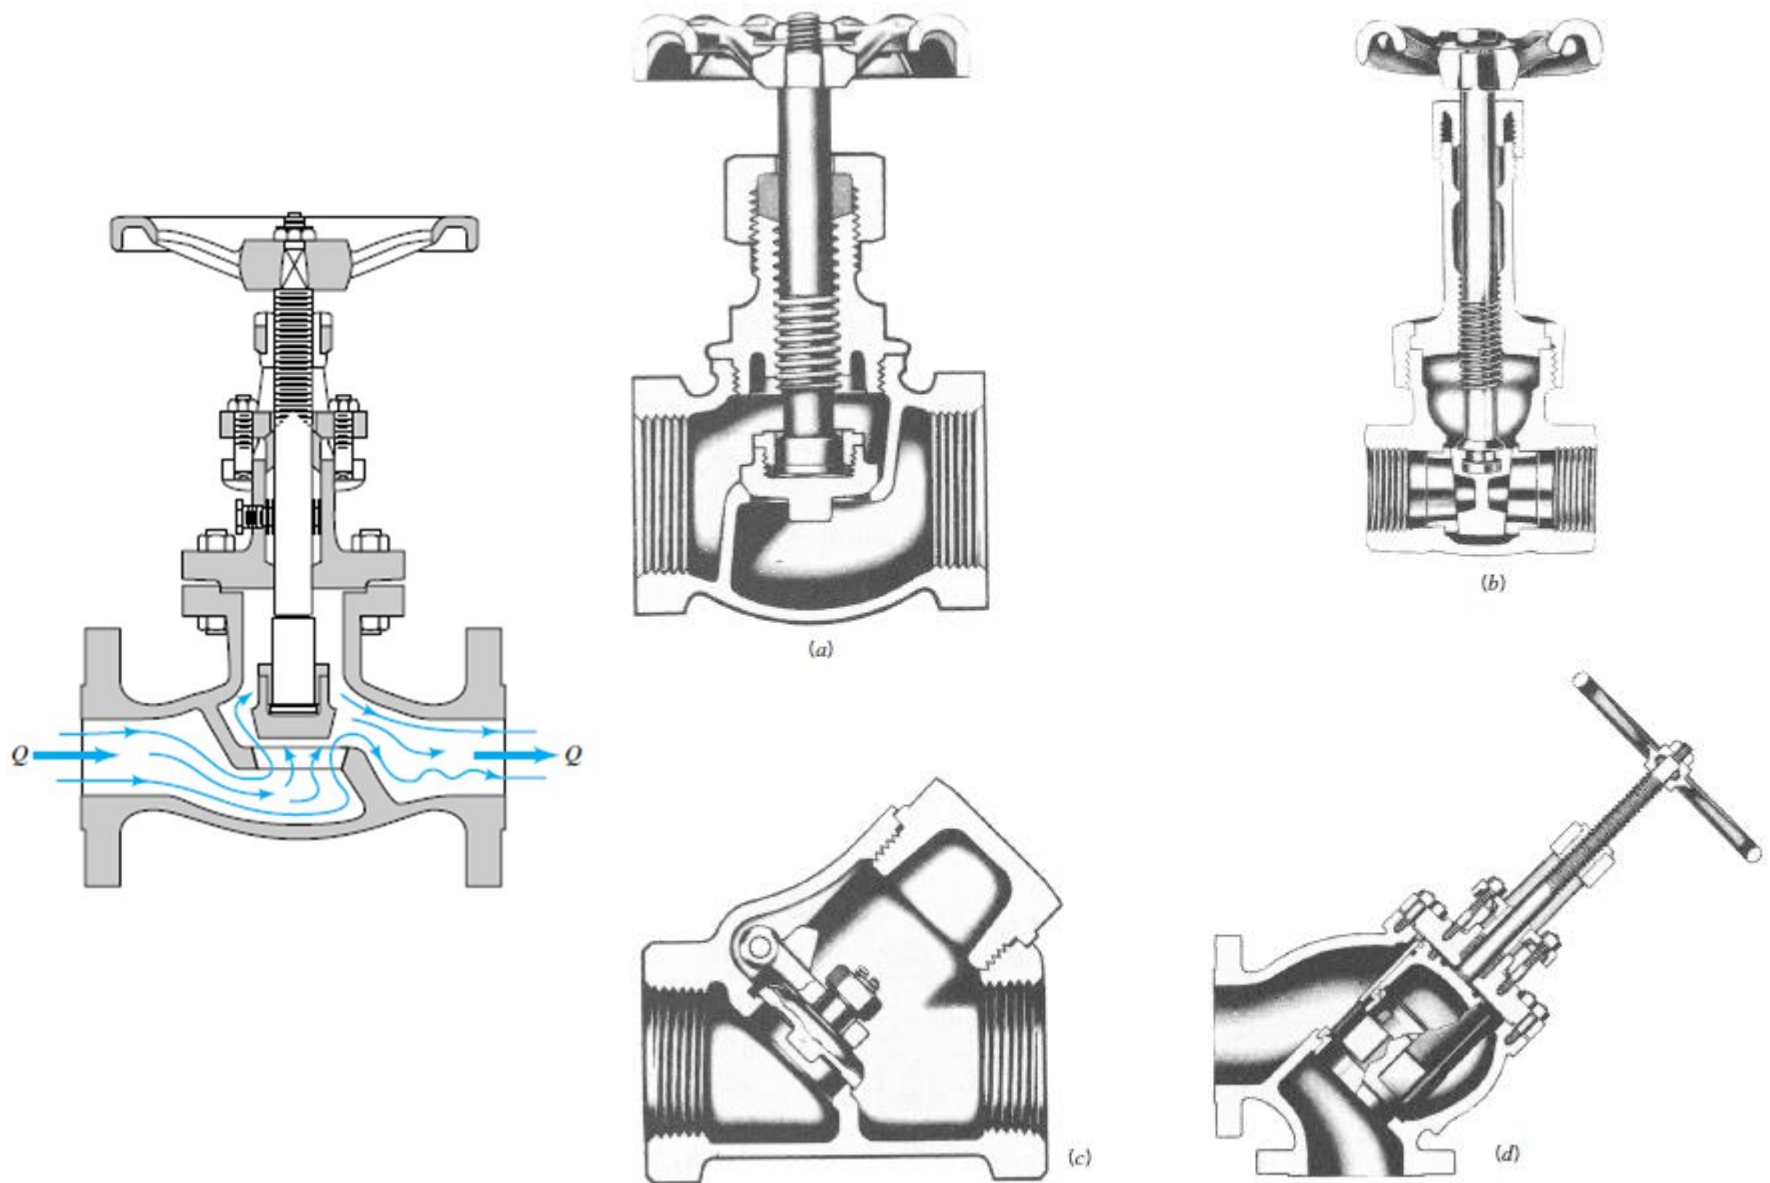

■ **FIGURE 8.32** Internal structure of various valves: (a) globe valve, (b) gate valve, (c) swing check valve, (d) stop check valve. (Courtesy of Crane Co., Valve Division.)



Válvula globo: grande perda de carga

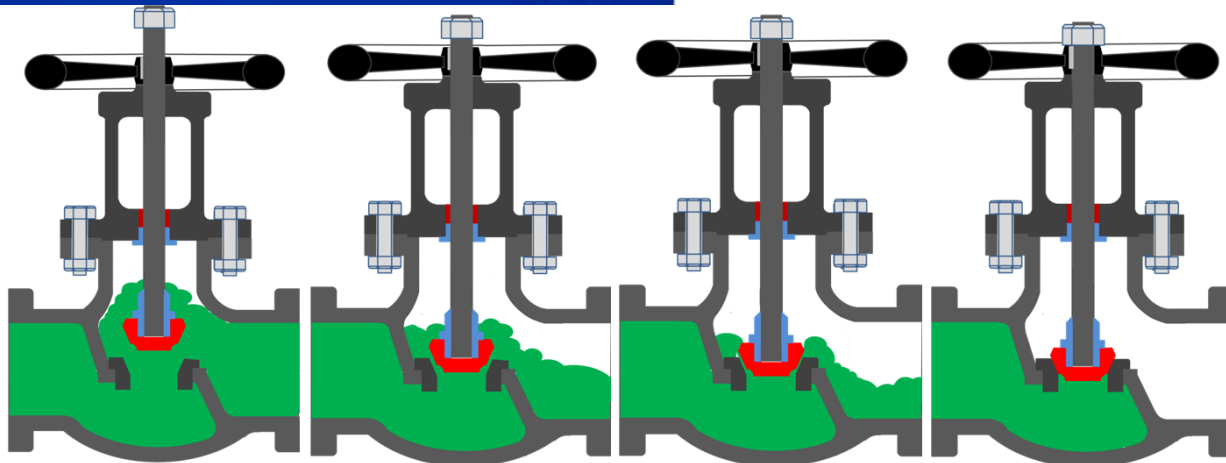



1. Fully Open

2. Throttling


3. Throttling

3. Fully Closed


Válvula de esfera:
menor perda de carga
quando aberta.

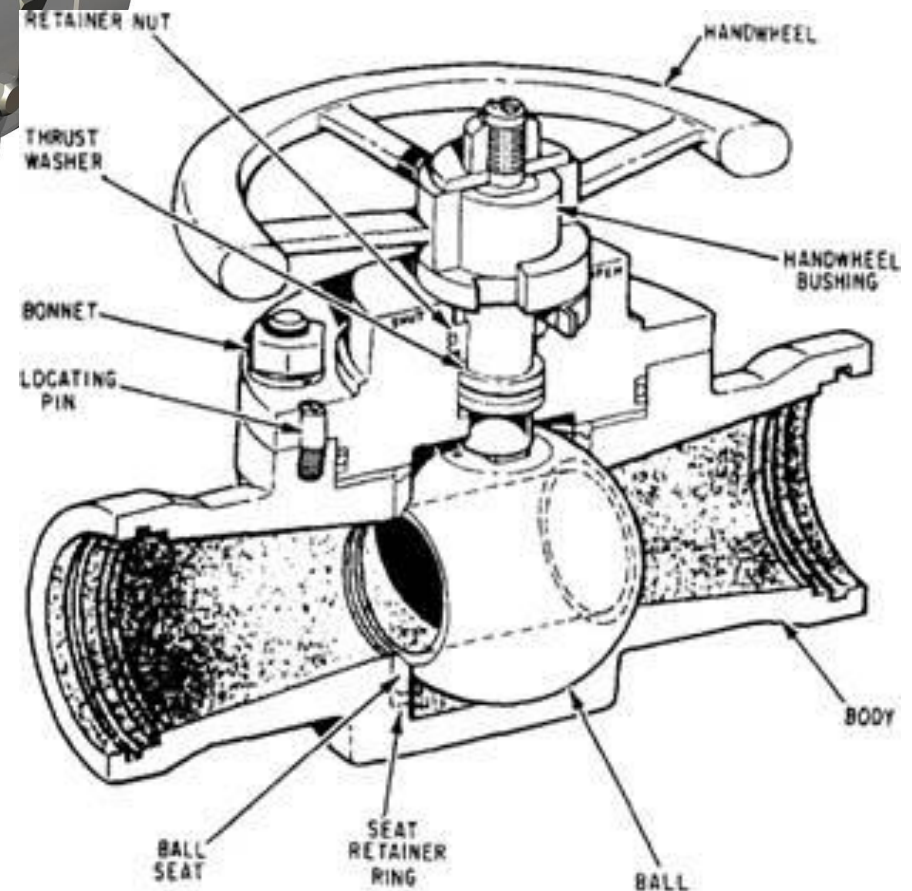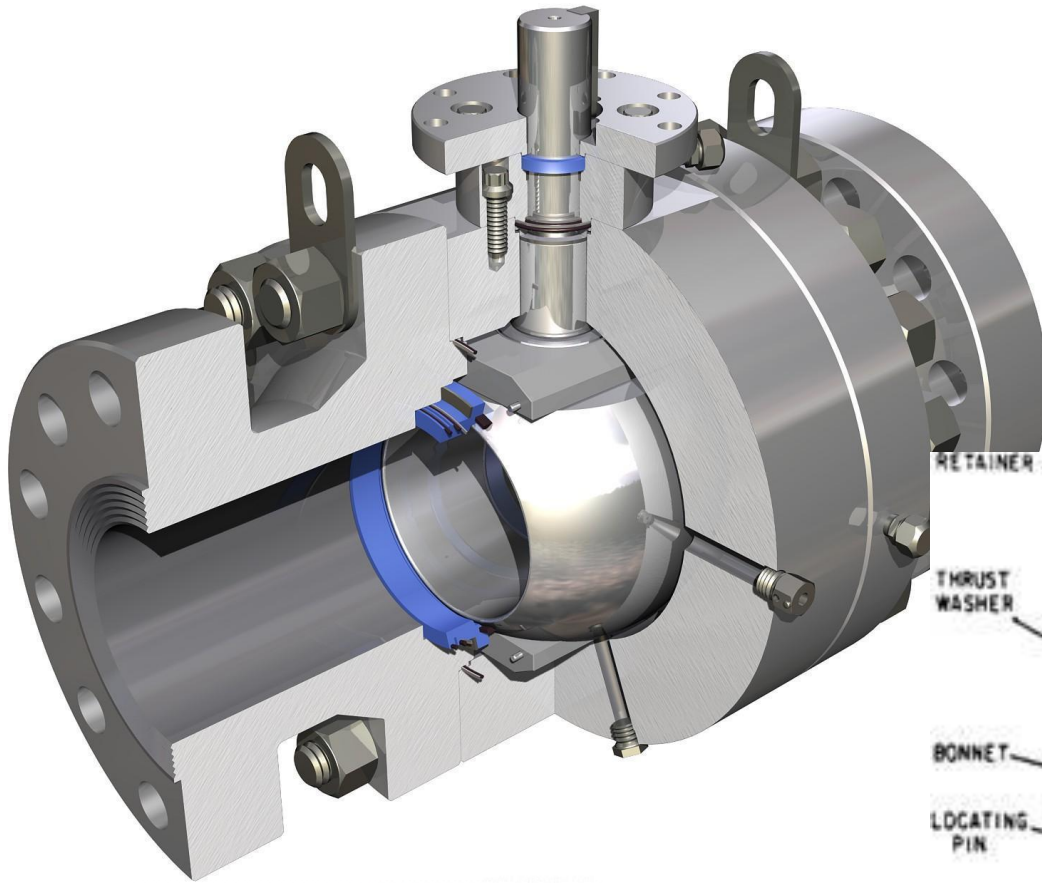

Válvula de Gaveta

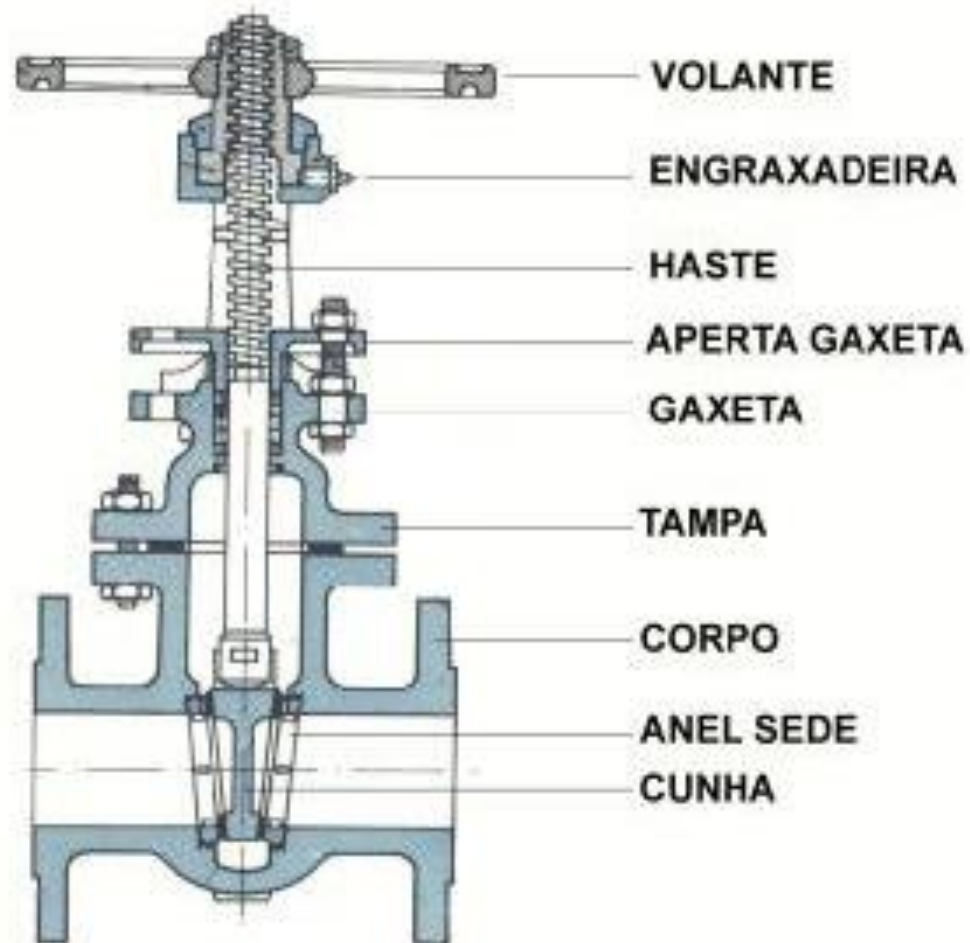


Registro de Gaveta

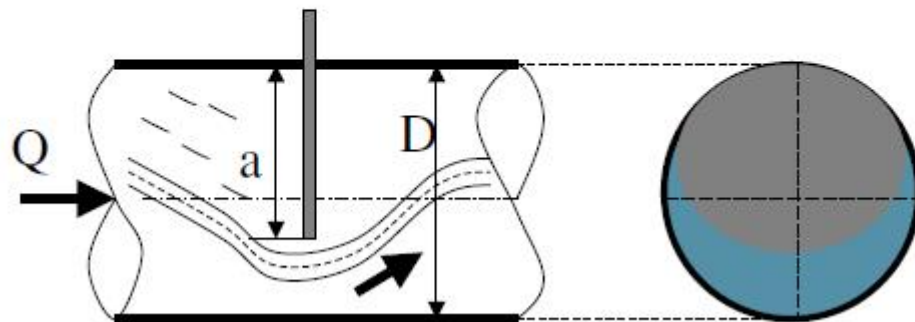




a/D	0	1/4	3/8	1/2	5/8	3/4	7/8
K	0,15	0,26	0,81	2,06	5,52	17,0	97,8




Válvula Borboleta

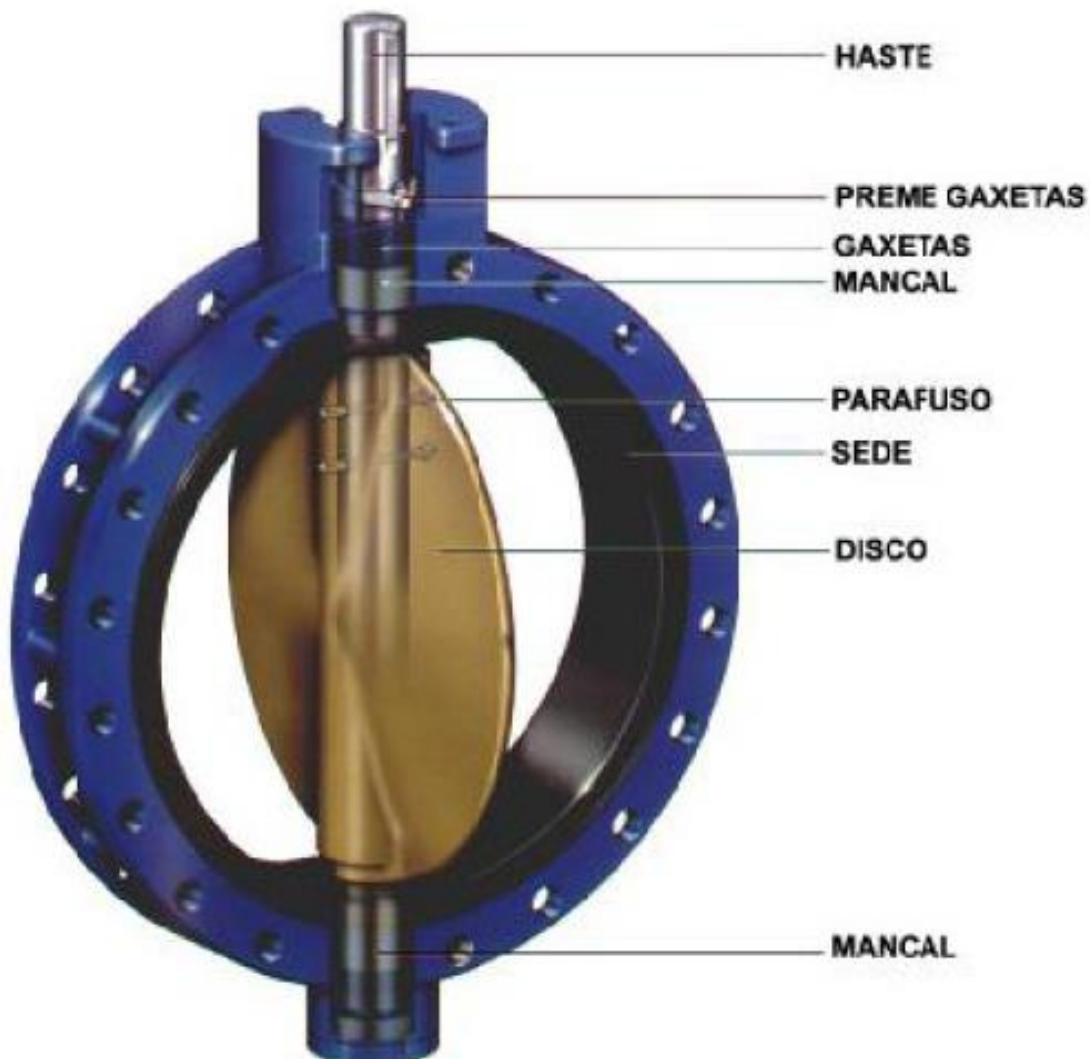


Válvula Borboleta

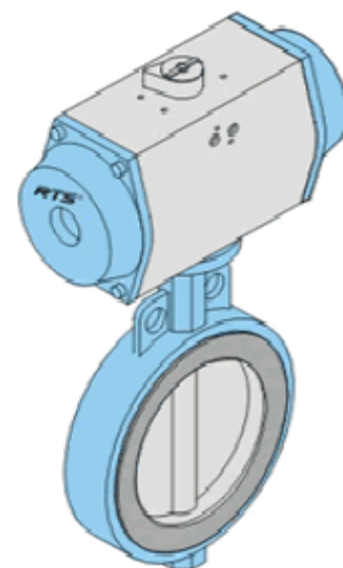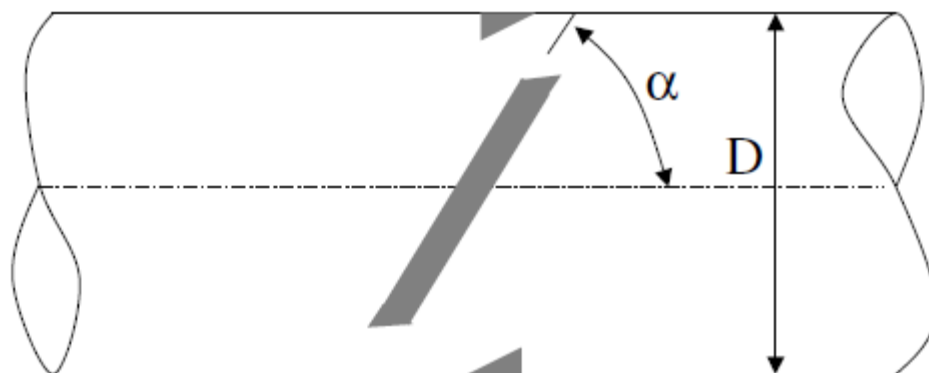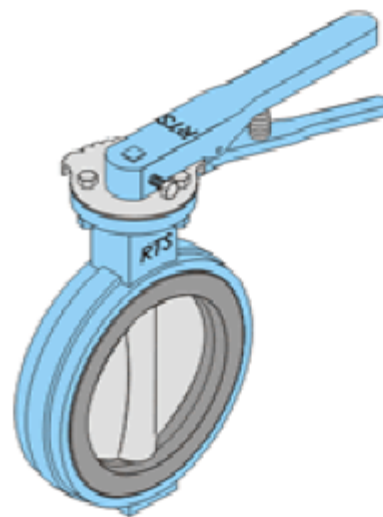


α°	0	5	10	15	20	25	30	35	40	45	50
K	0,15	0,24	0,52	0,90	1,54	2,51	3,91	6,22	10,8	18,7	32,6

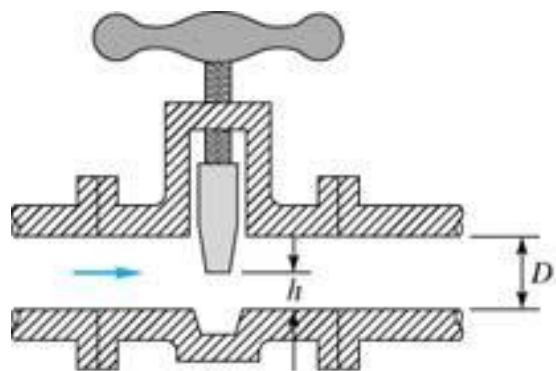


(a)

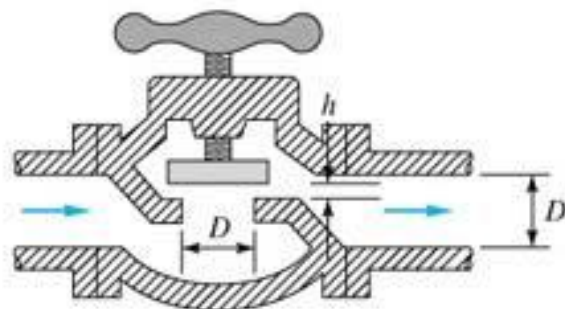


(b)

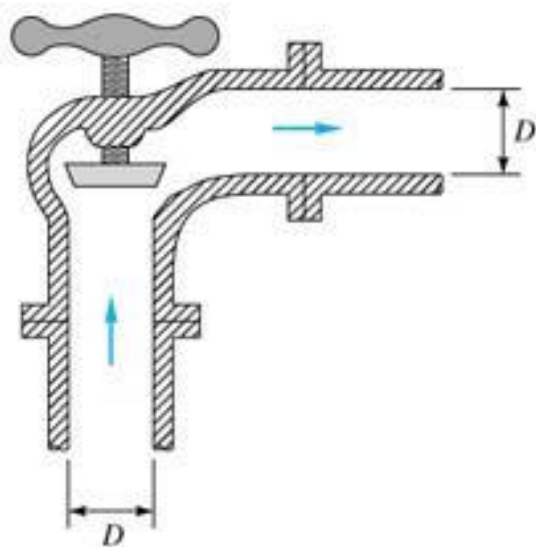

(c)

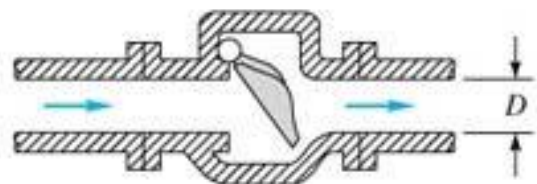

(d)

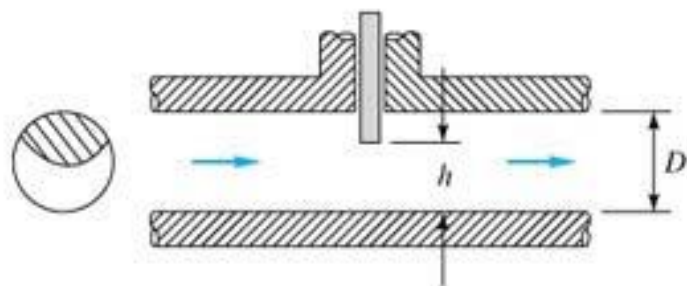


















(e)

BASIC VALVE MECHANISMS

FLUID CONTROL ELEMENTS (DISCS)


CHART 3.1

IN THESE SCHEMATIC DIAGRAMS, THE DISC IS SHOWN WHITE, THE SEAT IN SOLID COLOR, & THE CONVEYED FLUID SHADED.


OPERATED VALVES				SELF-OPERATED VALVES	
GATE	GLOBE	ROTARY	DIAPHRAGM	CHECK	REGULATING
 SOLID-WEDGE GATE	 GLOBE	 ROTARY-BALL	 DIAPHRAGM (SAUNDERS TYPE)	 SWING CHECK	 PRESSURE REGULATOR
 SPLIT-WEDGE GATE	 ANGLE GLOBE	 BUTTERFLY	 PINCH	 BALL CHECK	 PISTON CHECK
 SINGLE-DISC SINGLE-SEAT GATE	 NEEDLE	 PLUG or COCK	 PRESSURIZING FLUID *Central seat is optional SQUEEZE	 TILTING DISC CHECK	 STOP CHECK

Acessório	K
Cotovelo de 90° raio curto	0,9
Cotovelo 90° raio longo	0,6
Cotovelo de 45°	0,4
Curva 90°, r/D=1	0,4
Curva de 45°	0,2
Tê, passagem direta	0,9
Tê, saída lateral	2,0







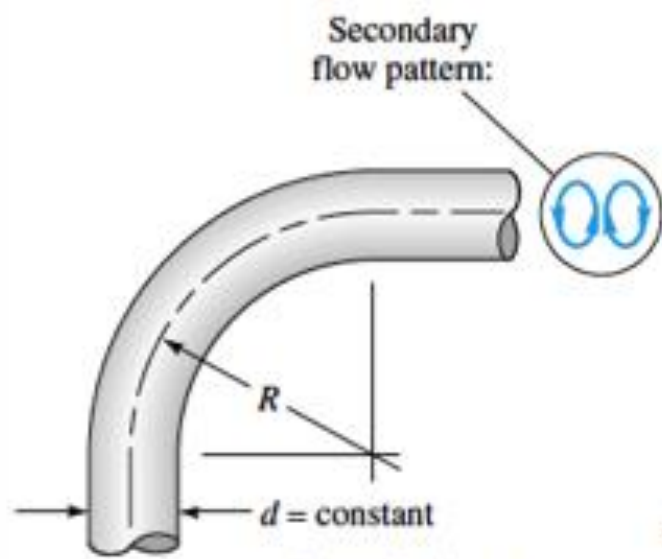


(Note: Resistance due to bend length must be added.)

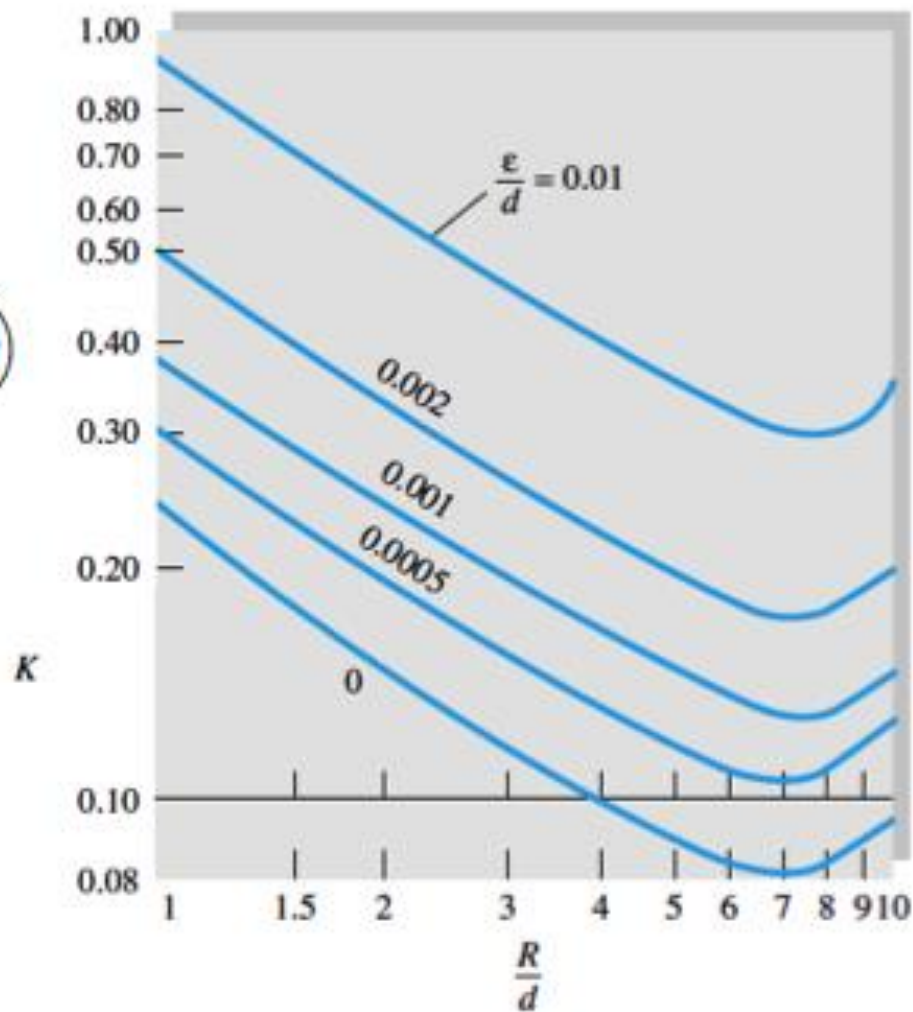


■ TABLE 8.2

Loss Coefficients for Pipe Components $\left(h_L = K_L \frac{V^2}{2g}\right)$ (Data from Refs. 5, 10, 27)


Component	K_L	
a. Elbows		
Regular 90°, flanged	0.3	
Regular 90°, threaded	1.5	
Long radius 90°, flanged	0.2	
Long radius 90°, threaded	0.7	
Long radius 45°, flanged	0.2	
Regular 45°, threaded	0.4	
b. 180° return bends		
180° return bend, flanged	0.2	
180° return bend, threaded	1.5	
c. Tees		
Line flow, flanged	0.2	
Line flow, threaded	0.9	
Branch flow, flanged	1.0	
Branch flow, threaded	2.0	
d. Union, threaded		
	0.08	
*e. Valves		
Globe, fully open	10	
Angle, fully open	2	
Gate, fully open	0.15	
Gate, $\frac{1}{4}$ closed	0.26	
Gate, $\frac{1}{2}$ closed	2.1	
Gate, $\frac{3}{4}$ closed	17	
Swing check, forward flow	2	
Swing check, backward flow	∞	
Ball valve, fully open	0.05	
Ball valve, $\frac{1}{3}$ closed	5.5	
Ball valve, $\frac{2}{3}$ closed	210	

Tipos de entrada em dutos

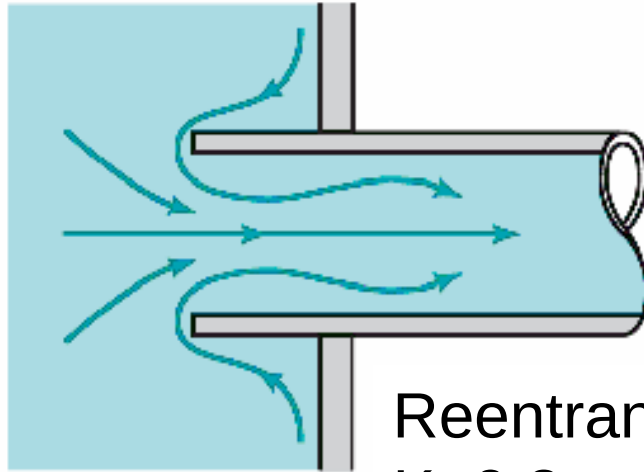


Reentrante
 $K=0,8$

(a)

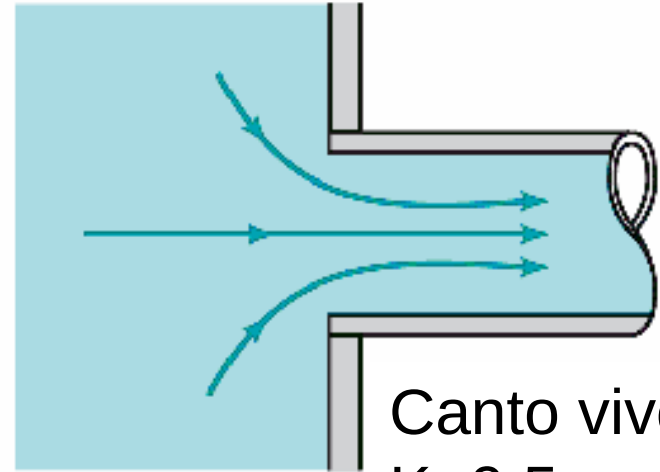


Canto vivo
 $K=0,5$

(b)

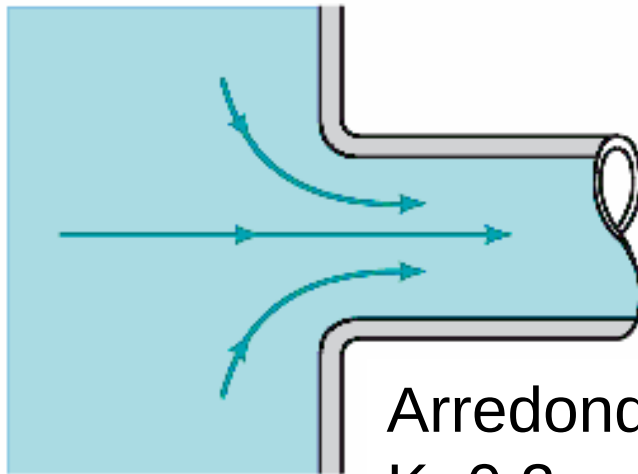

Arredondado
 $K=0,2$


(c)

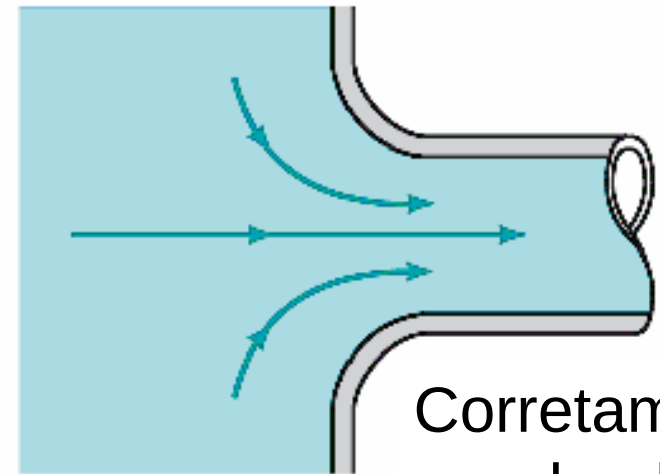


Corretamente
arredondado
 $K=0,04$

(d)


Tipos de saída de dutos

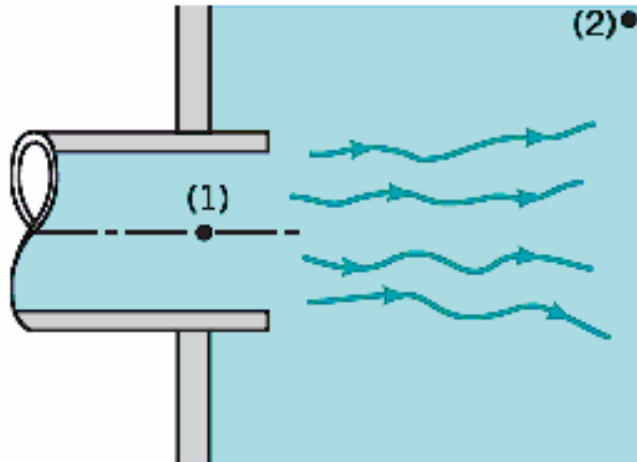

(a) Reentrante
 $K=1,0$

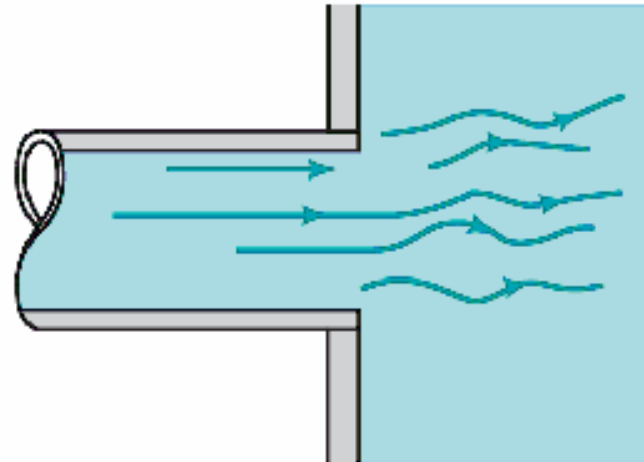


(b) Canto vivo
 $K=1,0$

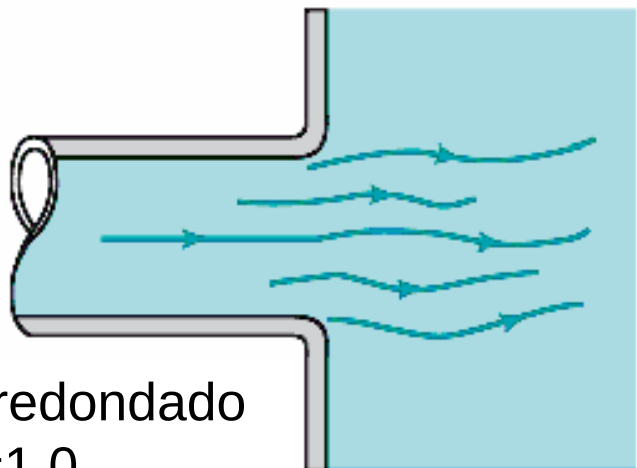


Arredondado
 $K=1,0$

(c)

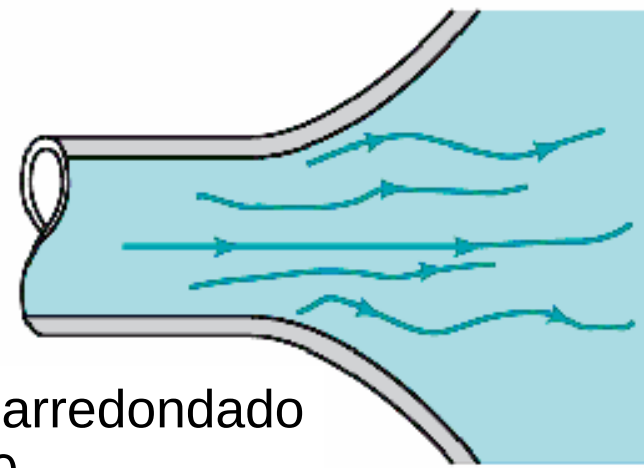

Bem arredondado
 $K=1,0$

(d)

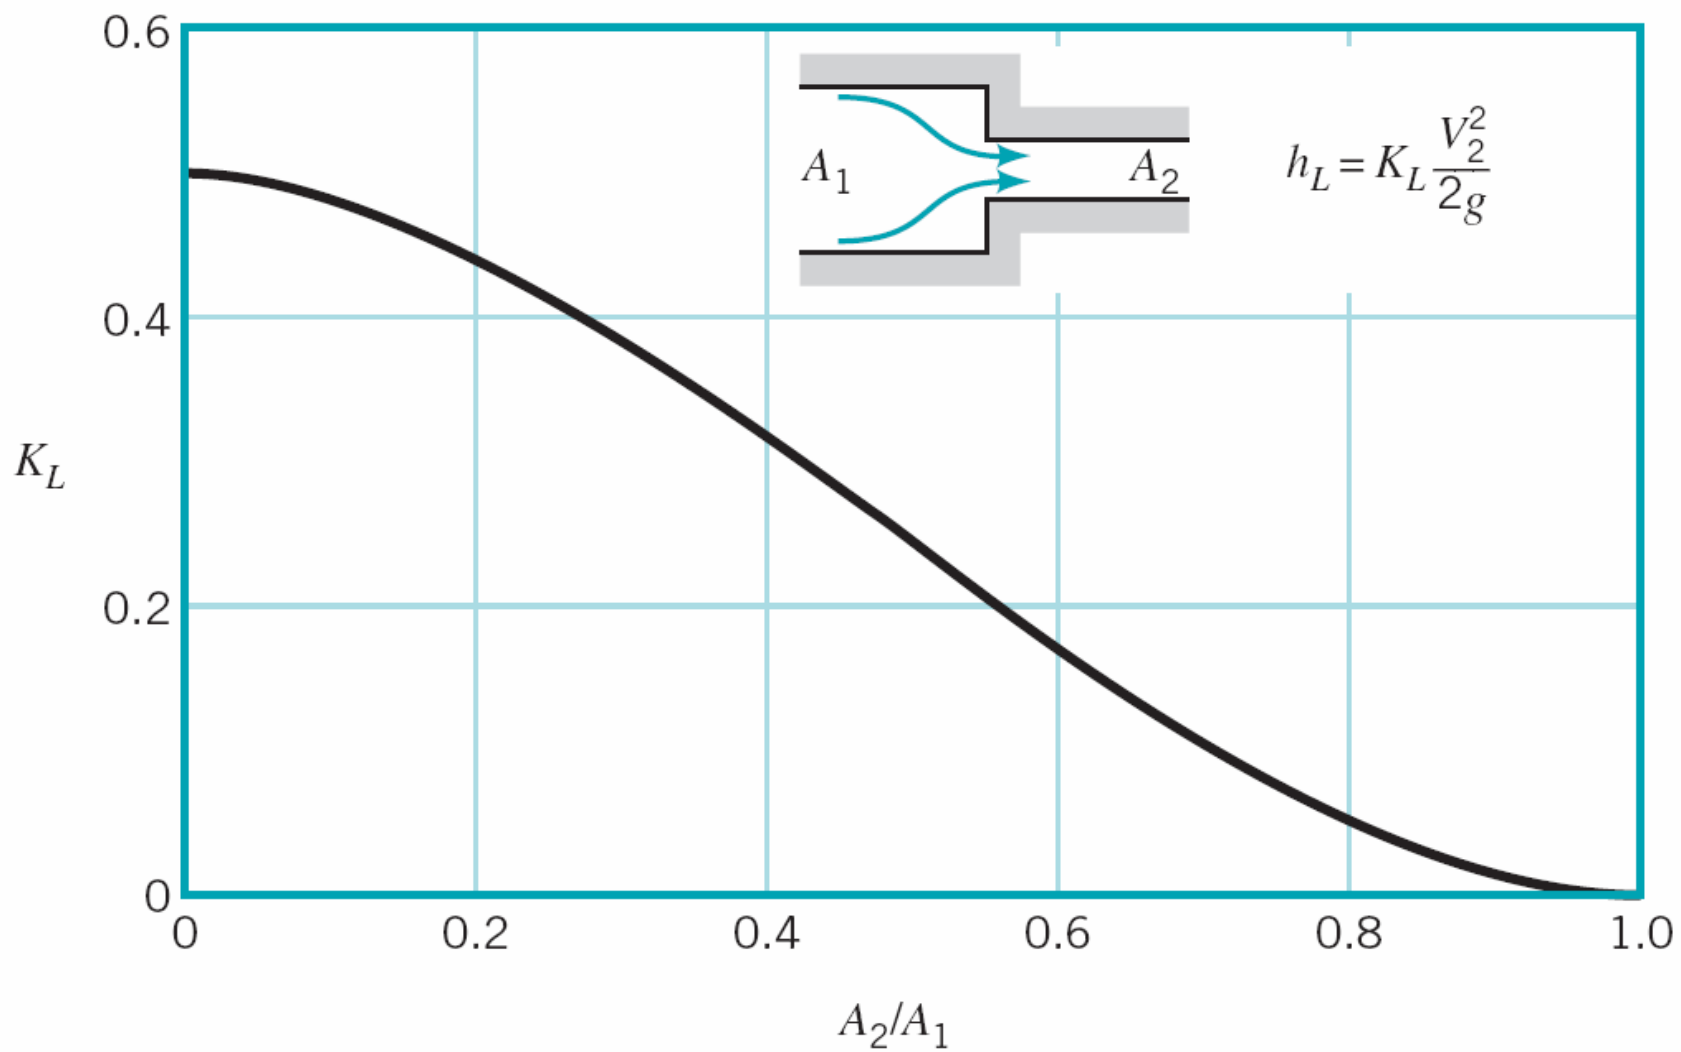







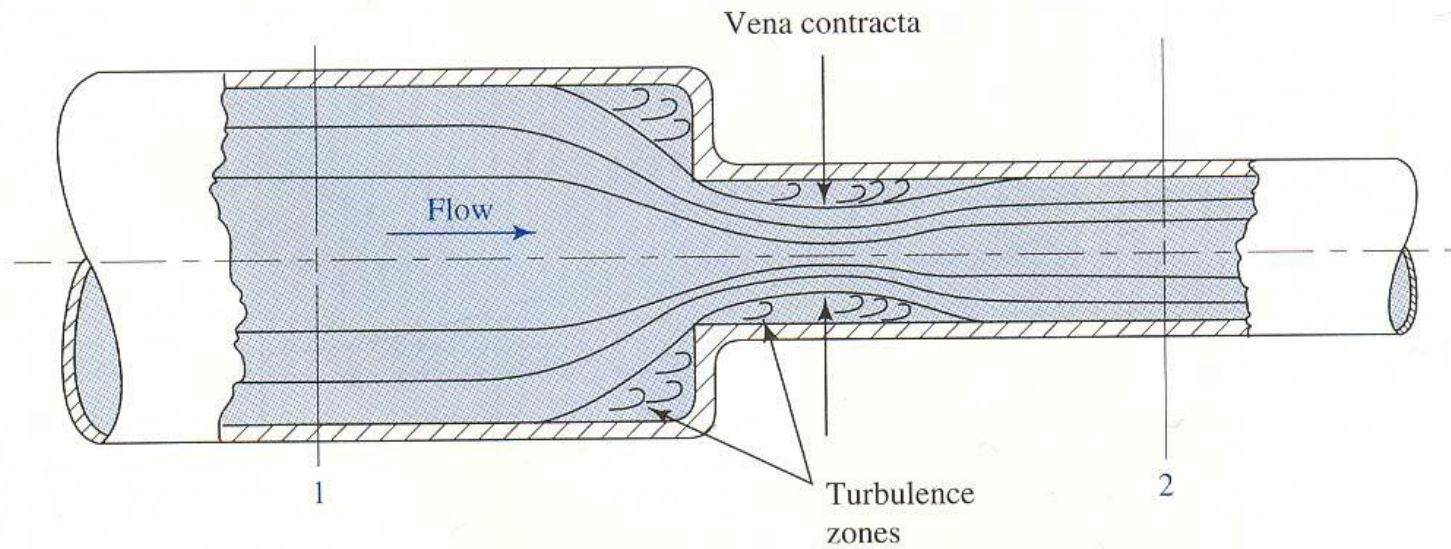




FIGURE 10.8 Vena contracta formed in a sudden contraction.

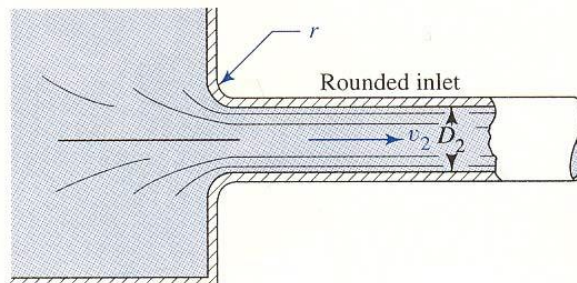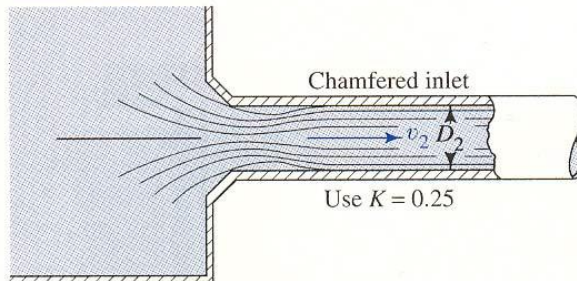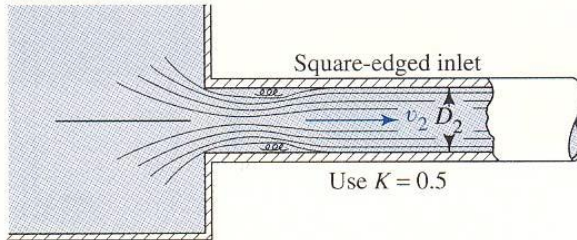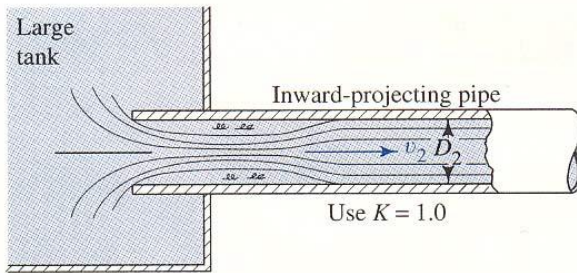



r/D_2	K
0	0.50
0.02	0.28
0.04	0.24
0.06	0.15
0.10	0.09
>0.15	0.04 (Well-rounded)

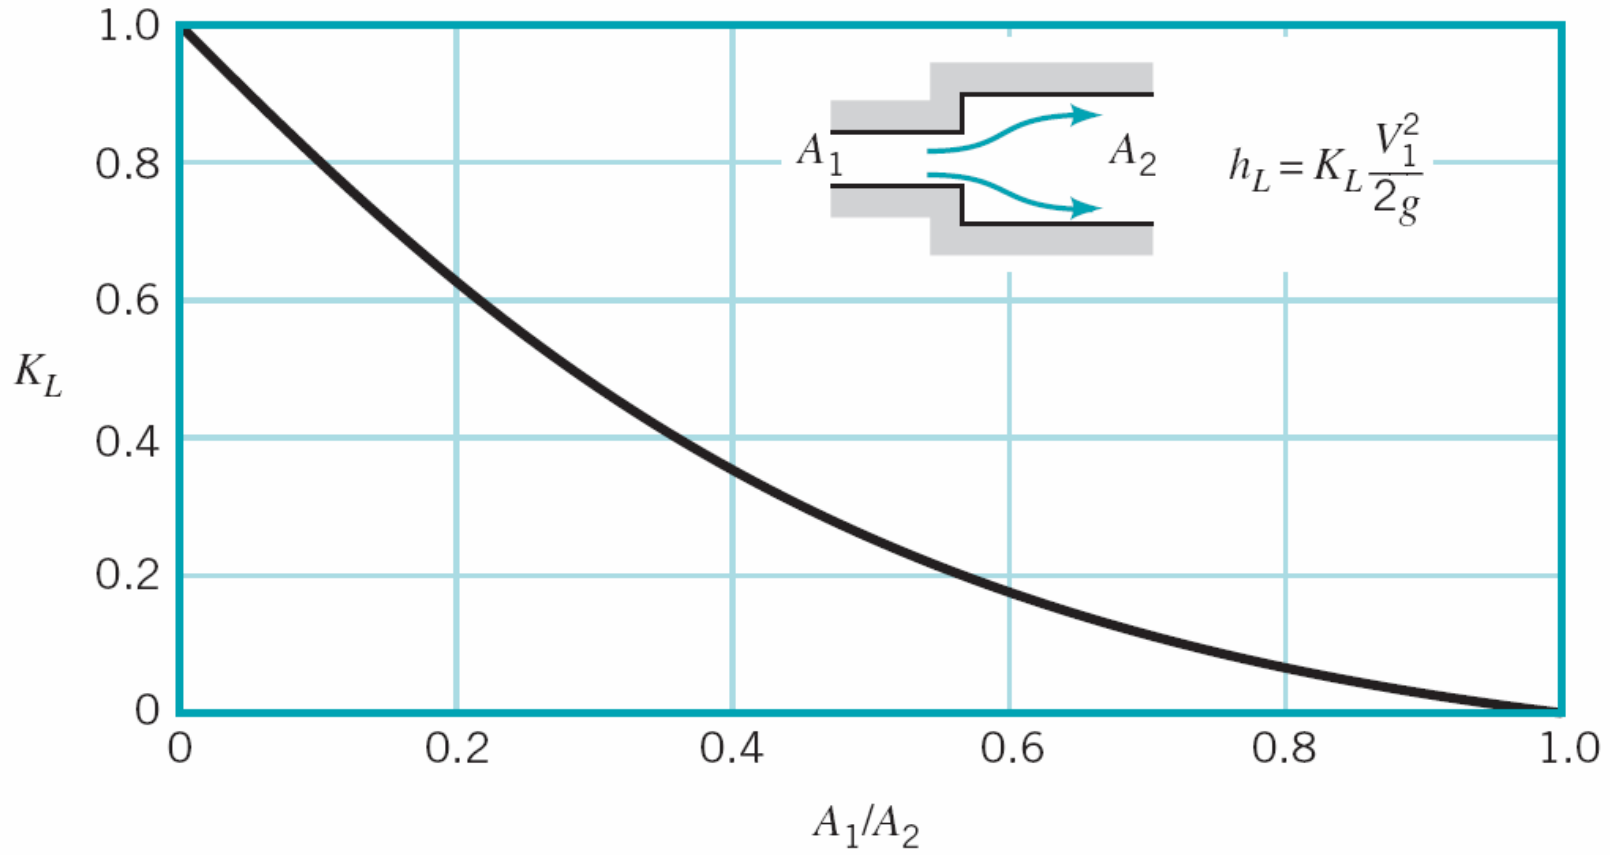


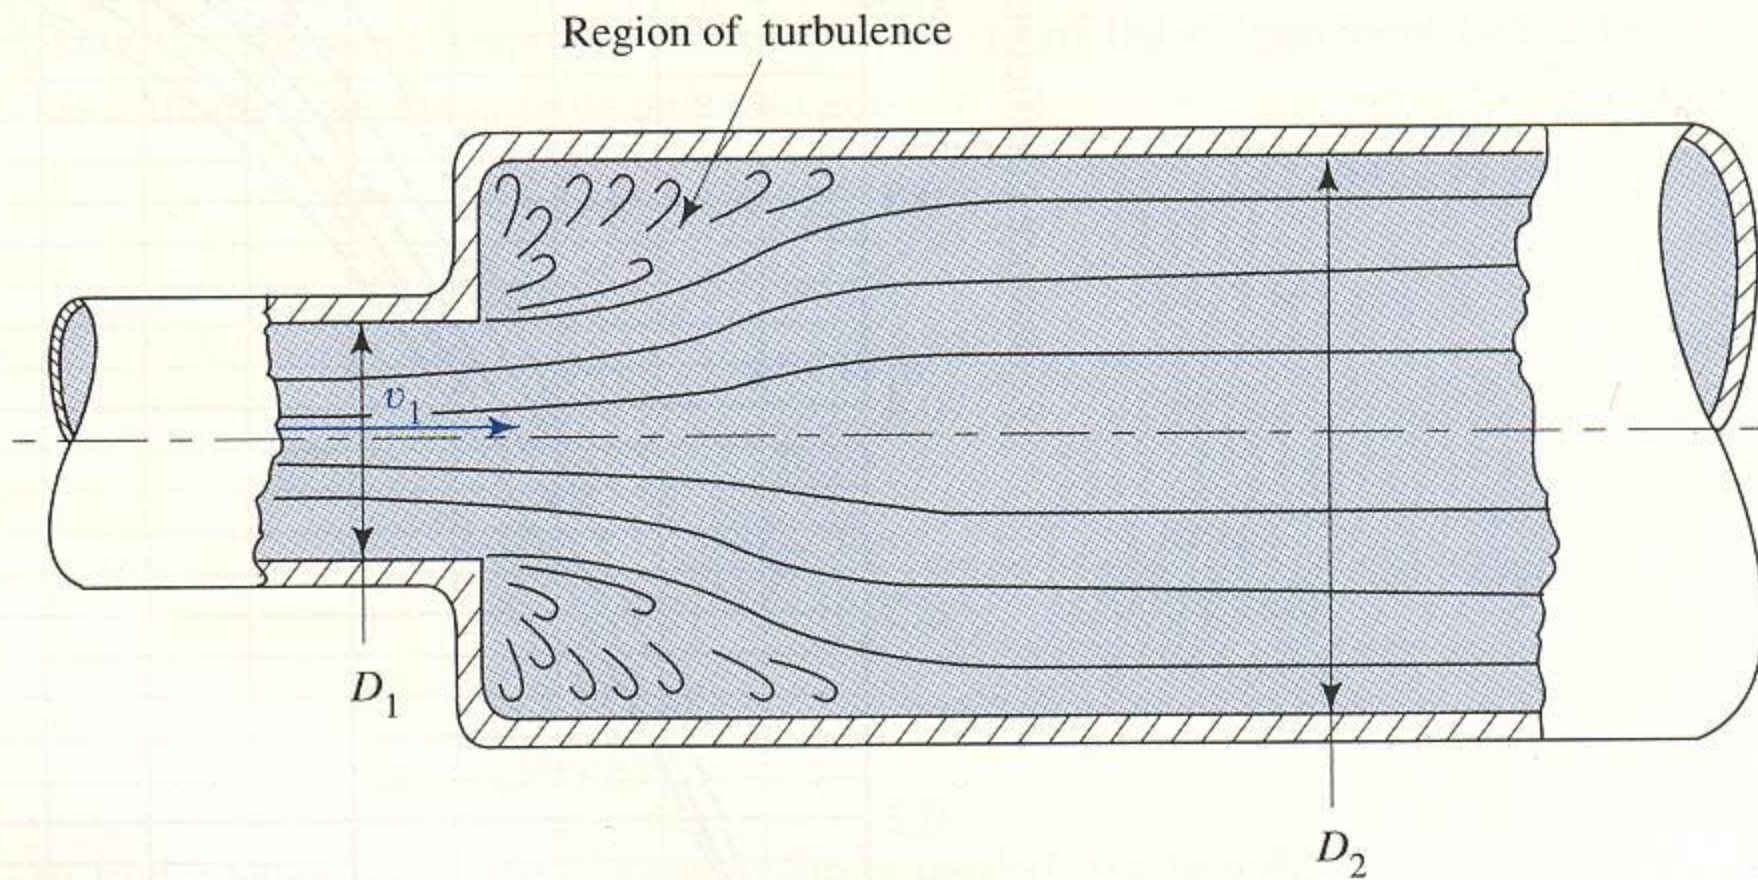


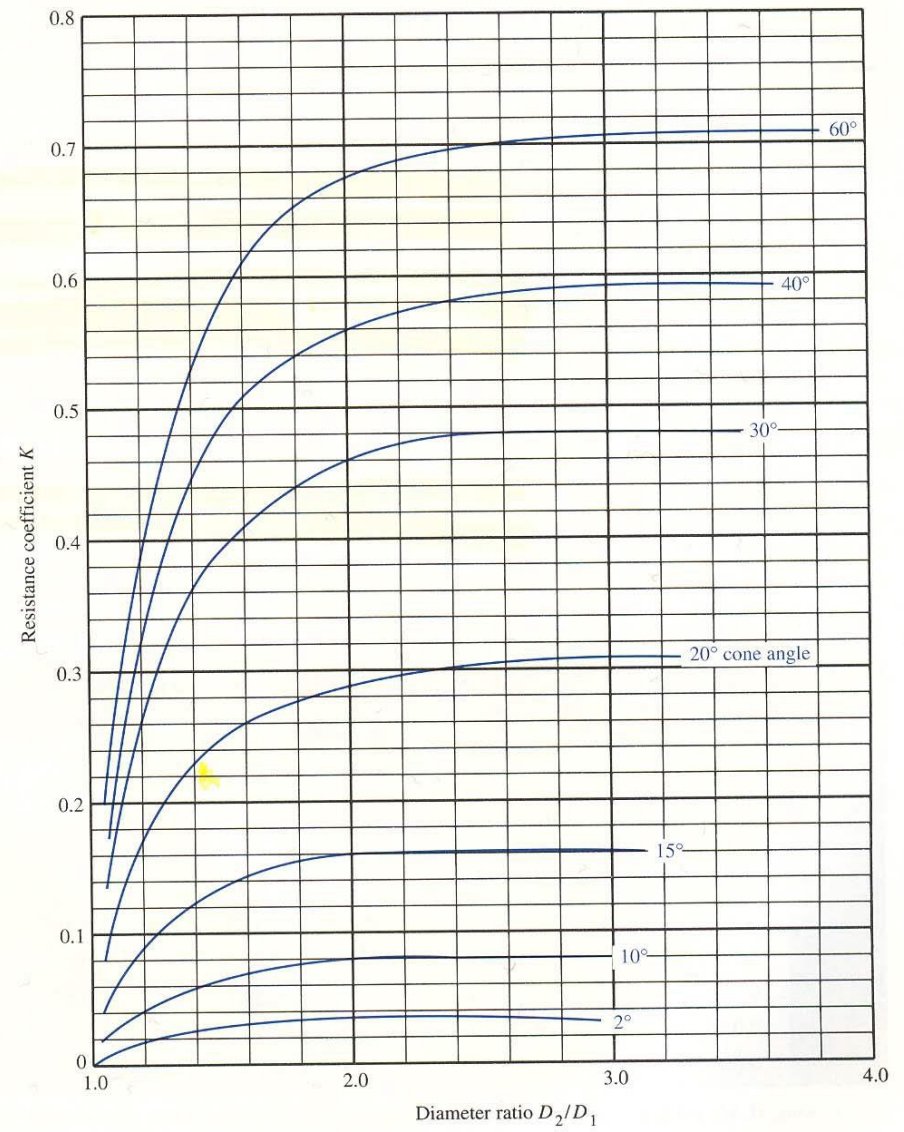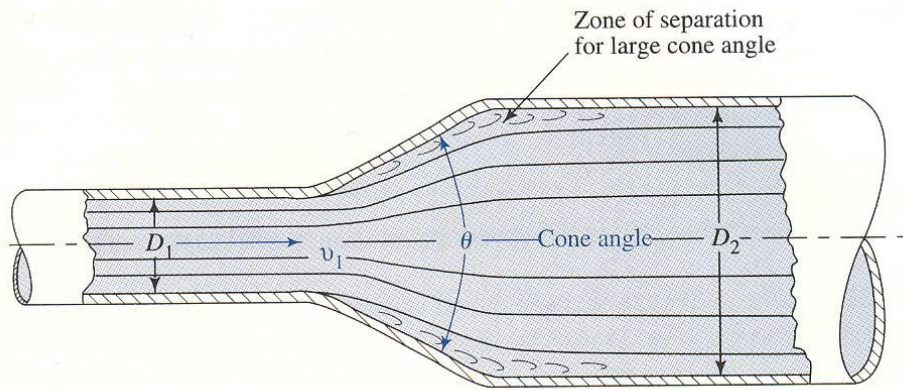

Alargamento gradual

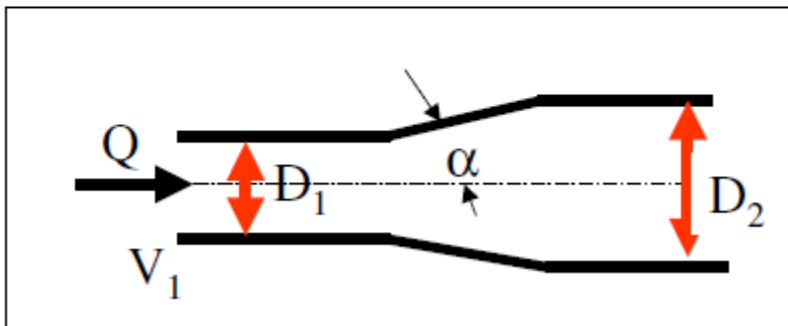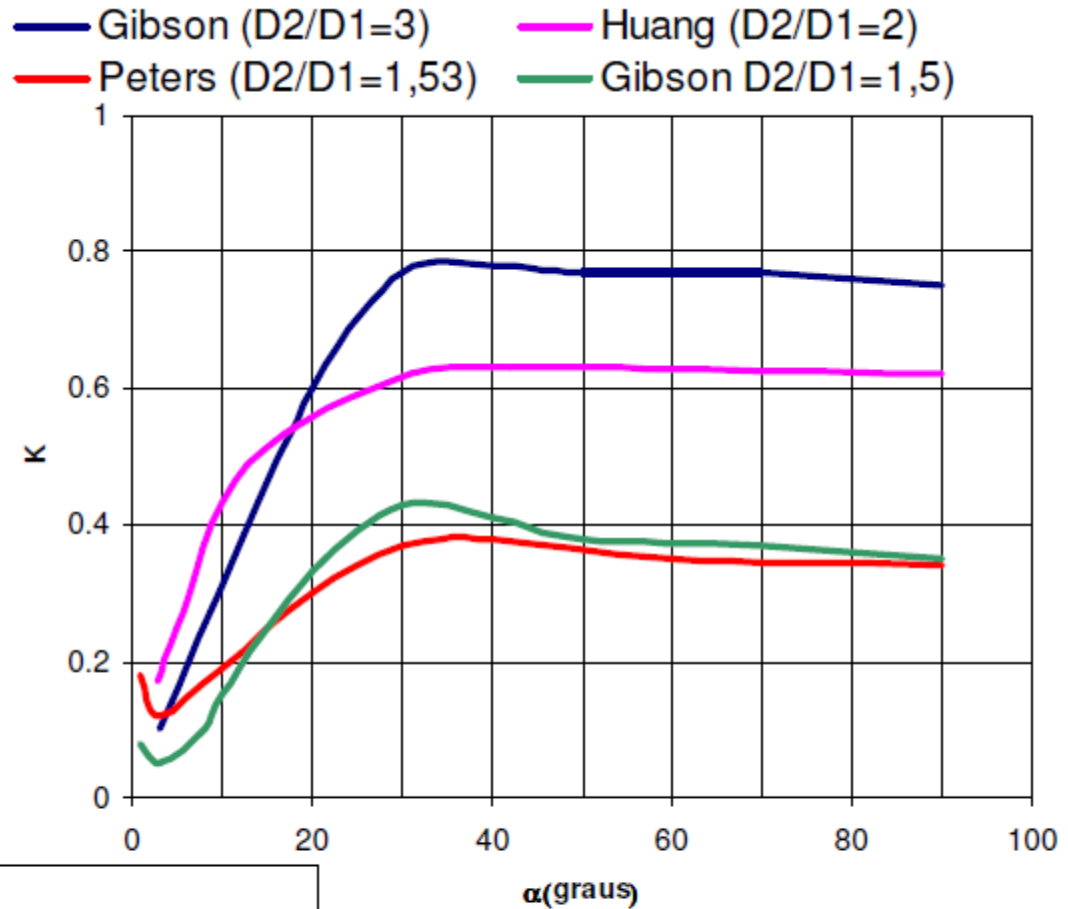

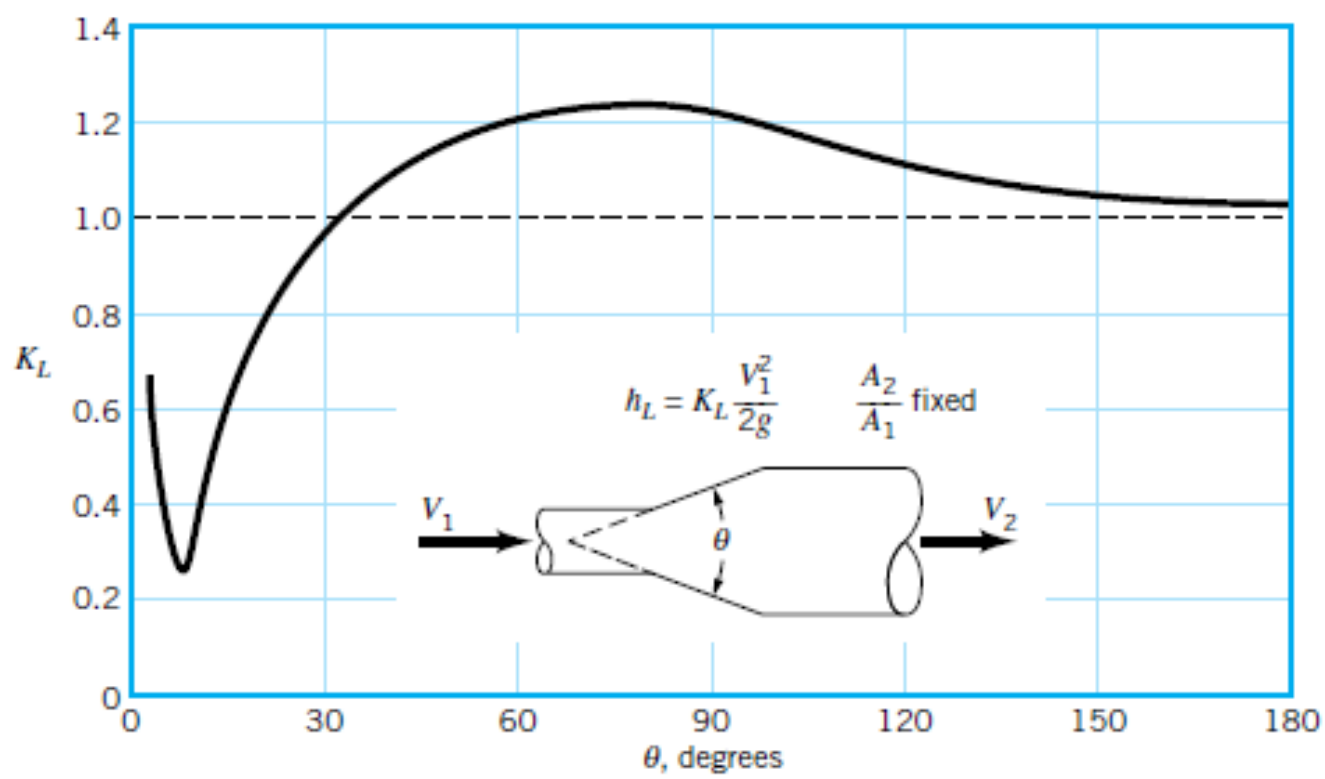


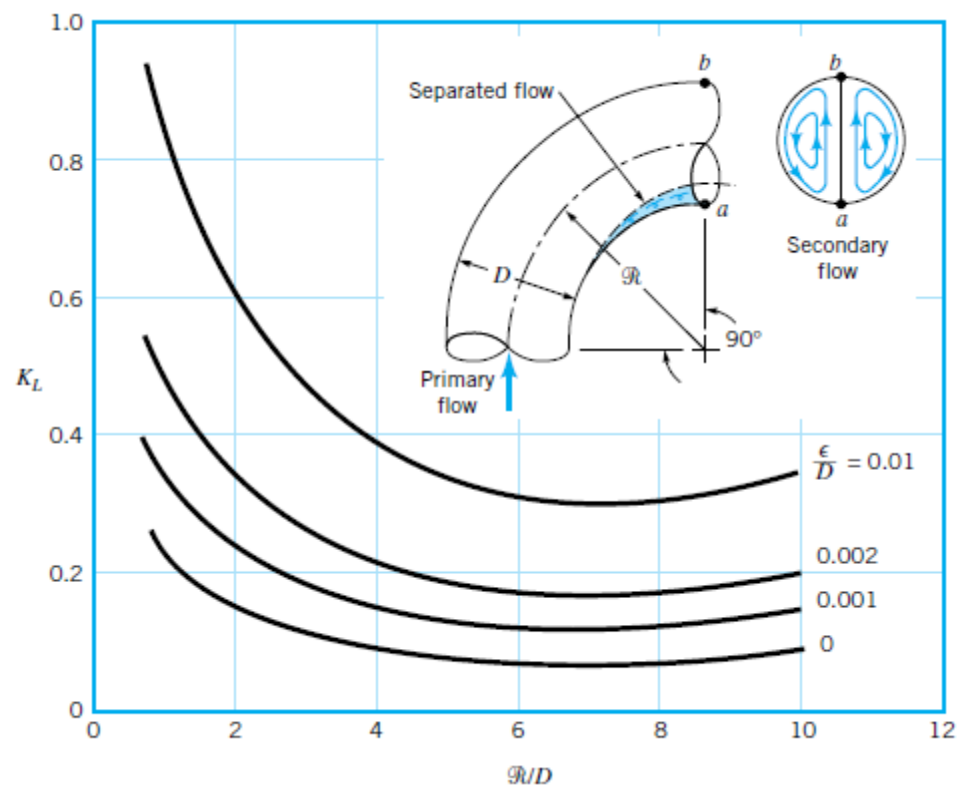


Minimizing Elbow Resistance

- The minimum resistance is achieved by an elbow when outer & inner radii is related as


$$\frac{r_1}{d_o} = \frac{r_o}{d_o} + 0.6$$

- The resistance of right angle elbows can greatly be reduced by installing a **fairing** on the inner corner
 - An optimum fairing with a ratio of $r_o/d_o = 0.45$ reduces the pressure losses by approx 50%
 - An additional fairing on the outer corner with a ratio of $r_1/d_o = 0.45$ reduces the losses by an additional 5%.
- Reduction in the elbow resistance can also be attained by beveling sharp corners of the bend especially the inner corner

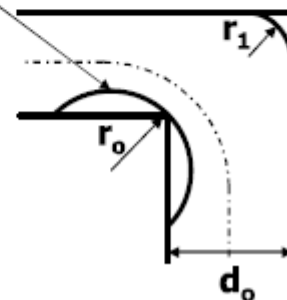

Minimizing Elbow Resistance

Example of a Coolant Return Elbow

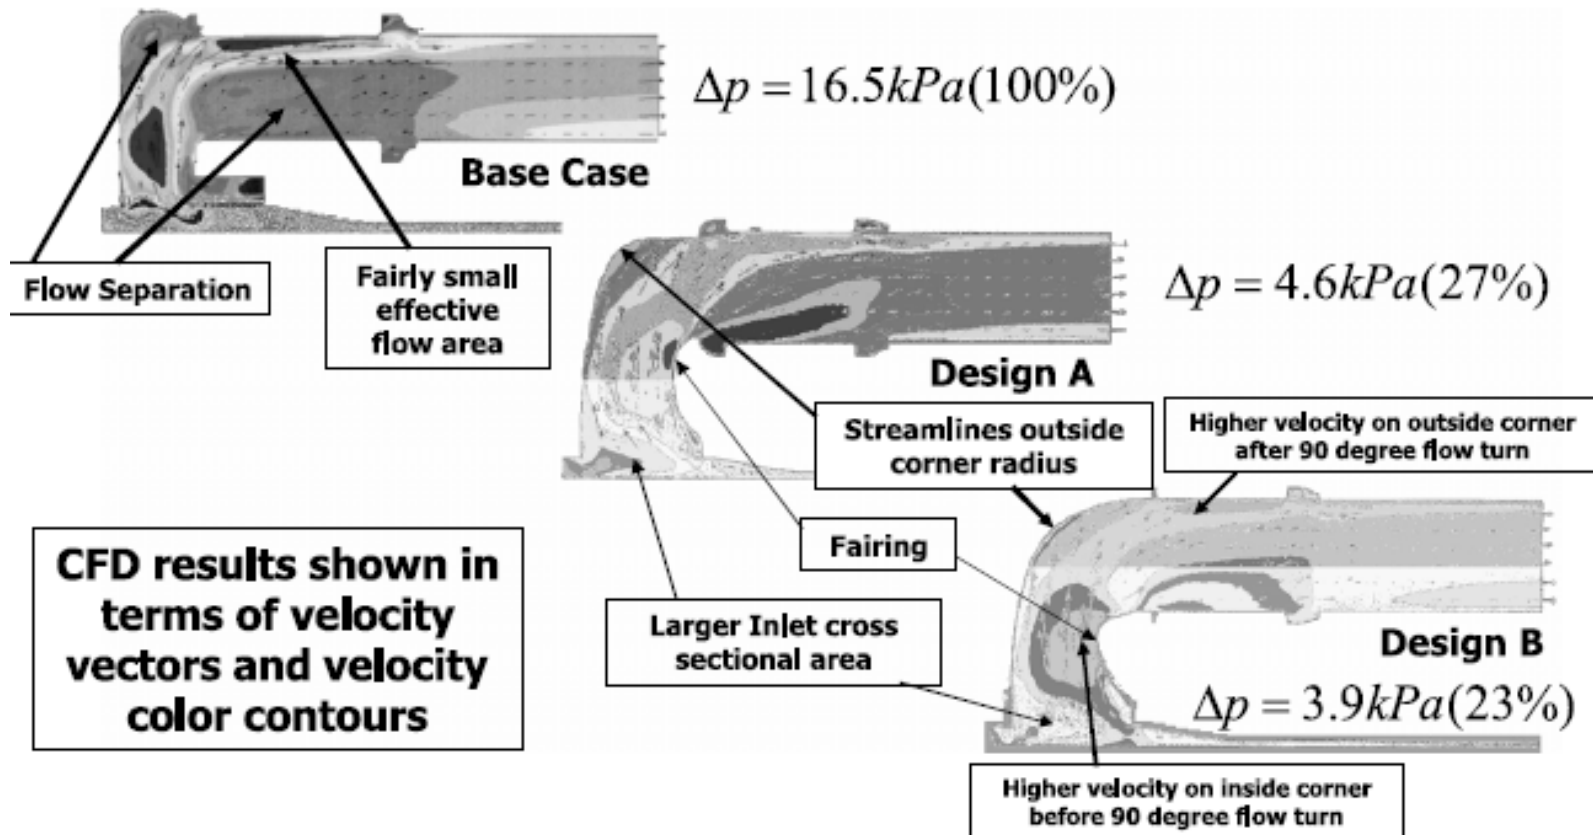


77% reduction in pressure losses is significant!

Circular Metal Wire Screens

Idelchik Diagram 8.6 Pg 522

$$\text{Re} = \frac{v_o \delta_m}{\mu} \geq 10^3$$

$$50 < \text{Re} < 10^3$$

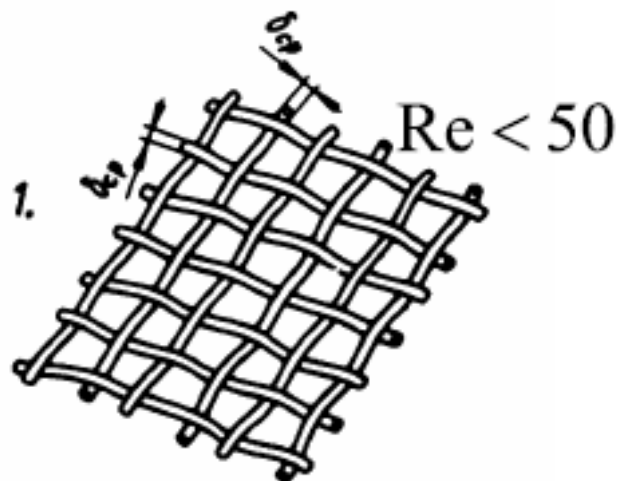

A_o is open area on screen

A_1 is pipe upstream flow area

$$K_{\text{Wire-Screen}} = 1.3 \left(1 - \frac{A_o}{A_1}\right) + \left(\frac{A_1}{A_o} - 1\right)^2$$

$$K_{\text{Wire-Screen}} = k_1 1.3 \left(1 - \frac{A_o}{A_1}\right) + \left(\frac{A_1}{A_o} - 1\right)^2$$

$$K_{\text{Wire-Screen}} = \frac{22}{\text{Re}} + 1.3 \left(1 - \frac{A_o}{A_1}\right) + \left(\frac{A_1}{A_o} - 1\right)^2$$

Base area is A_o

